


Item# 657252 ActronAir Gateway Wiring

For ActronAir Interface Board ICUNO-MOD (for Outdoor, **purchased from ActronAir**)

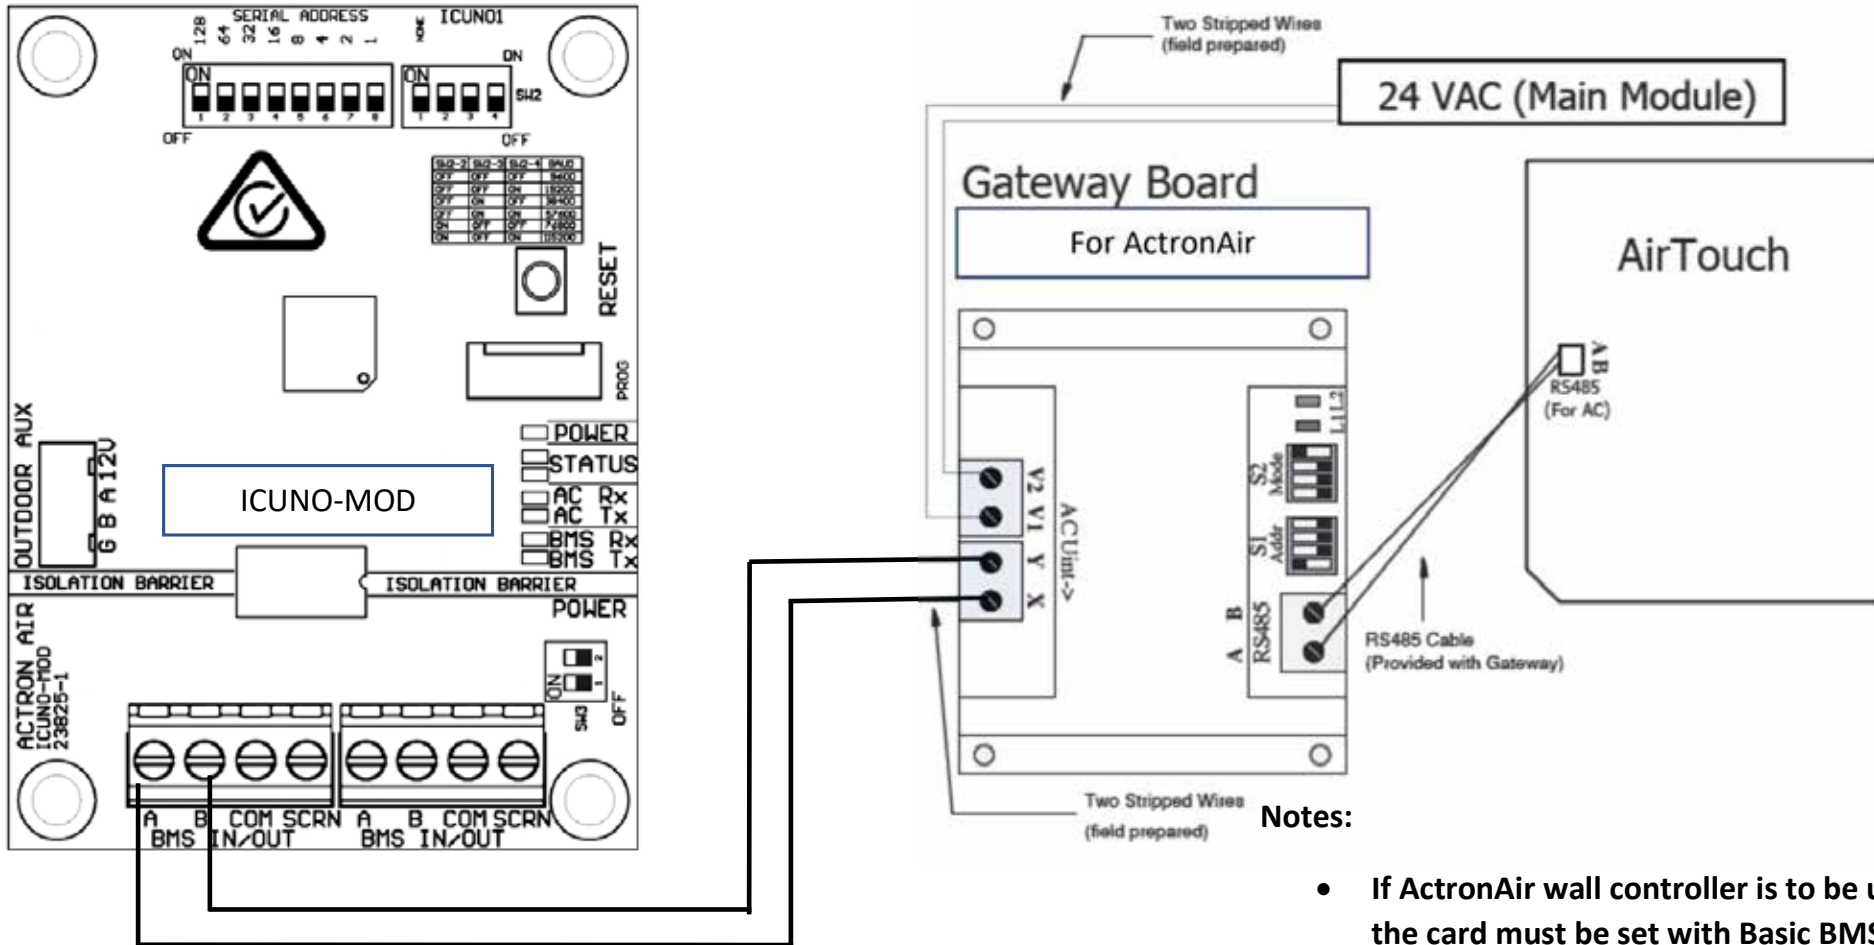

On ActronAir ICUNO-MOD board On Gateway 657252

- SW1:00000000
- SW2:0000
- SW3: 00
- S1: 1000
- For connection to ICUNO-MOD: S2:0001

Notes:

- If ActronAir wall controller is to be used with 657252, the card must be set with Basic BMS Control
- Connect the ActronAir Interface Board to the AC outdoor as per ActronAir's instructions
- Disable Continuous Fan with Actron wall controller
- Wall controller or AERSS sensor should be installed